





APPROVAL SHEET




NFPA#96 3" Overall Clearance Duct Chase

Flat Steel Deck

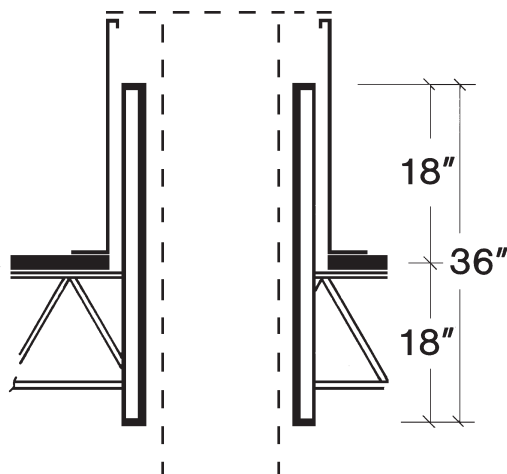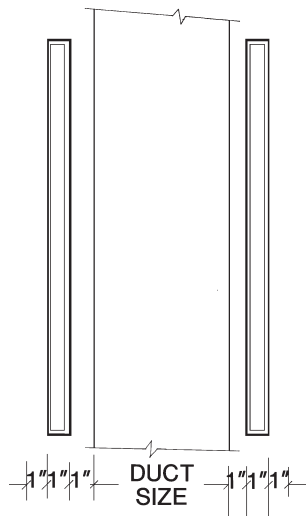

Job Name:		
Dealer:		
Model	Duct Size	Roof
P.O. #:	By:	Date:
Fabrication cannot begin until sheet is signed		
Approved by		Date

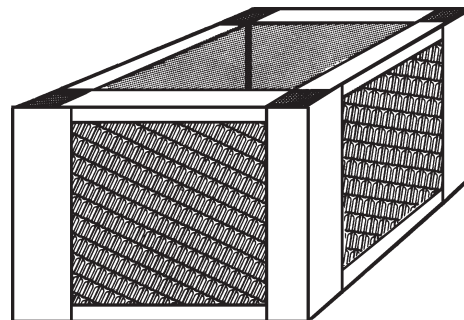

Specifications

- Sturdi-Bilt "96D" Series Duct Chase: National Fire Protection Association Code #96 Clearance Reduciton Sytem, 3 Inch Overall Clearance to Combustible Material. Constructed of 22 gauge Sheet metal, 1" mineral wool bat and wire mesh. Clearance redution system must be installed on the combustible material with 1" clearance, and 18" clearance from the top of the system to the combustible material. System must be attached to combustible material with a non combustible spacer such as stacked washers, small diameter pipe, tubing, or electrical conduit. Includes instal-
- lation instructions.